



Example of the operating data menu – please record and submit when commissioning and following service visits.

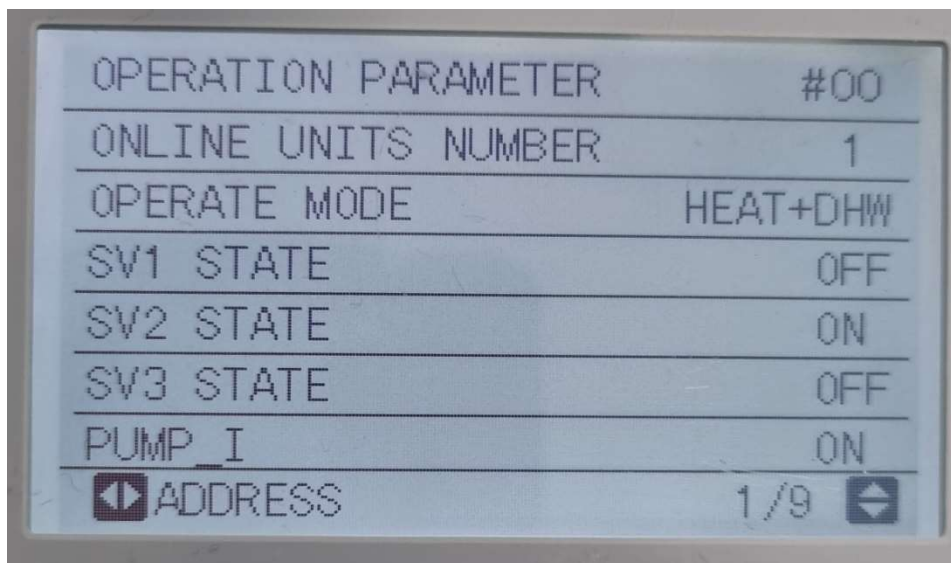


OPERATION PARAMETER	#00
ONLINE UNITS NUMBER	1
OPERATE MODE	HEAT+DHW
SV1 STATE	OFF
SV2 STATE	ON
SV3 STATE	OFF
PUMP_I	ON
◀ ADDRESS	1/9 ▶

Pump\_I ( must be on when unit is operating)

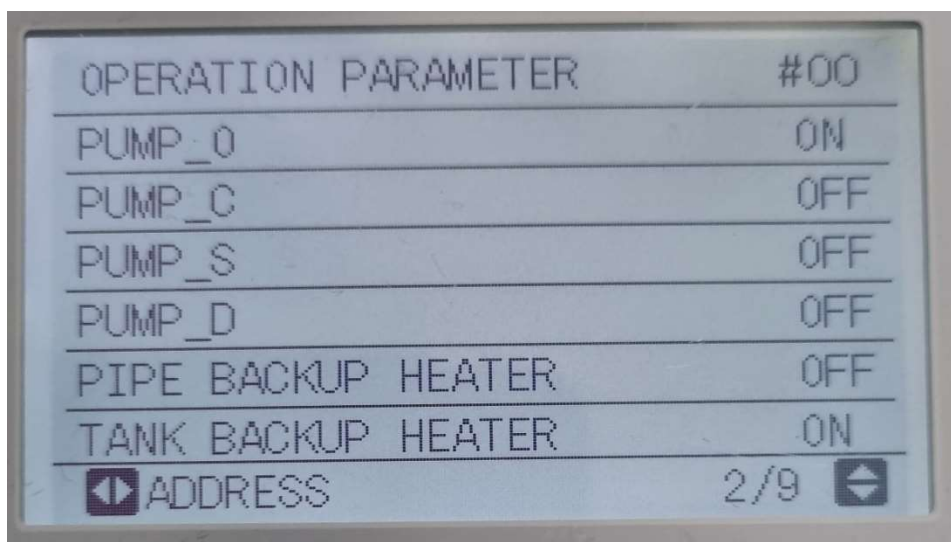


OPERATION PARAMETER	#00
PUMP_0	ON
PUMP_C	OFF
PUMP_S	OFF
PUMP_D	OFF
PIPE BACKUP HEATER	OFF
TANK BACKUP HEATER	ON
◀ ADDRESS	2/9 ▶

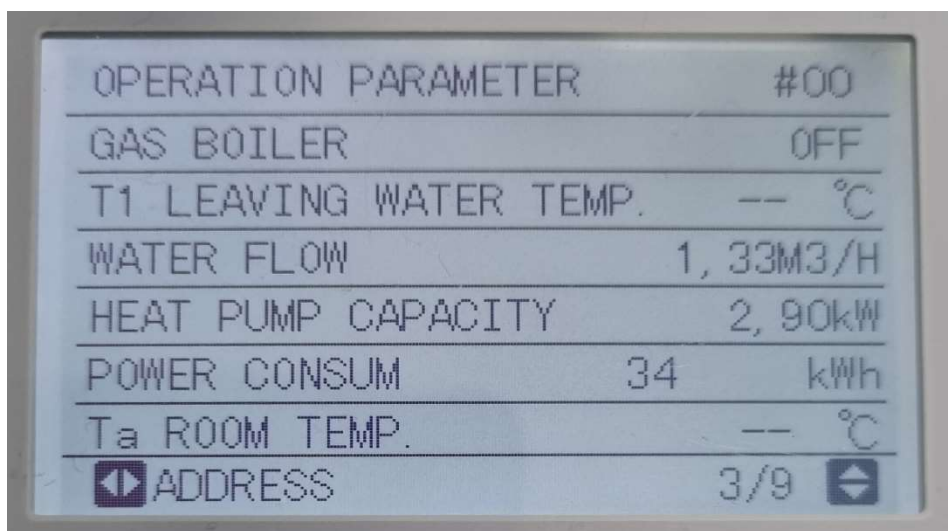


OPERATION PARAMETER	#00
GAS BOILER	OFF
T1 LEAVING WATER TEMP.	-- °C
WATER FLOW	1, 33M3/H
HEAT PUMP CAPACITY	2, 90kW
POWER CONSUM	34 kWh
Ta ROOM TEMP.	-- °C
◀ ADDRESS	3/9 ▶

Example of the operating data menu – please record and submit when commissioning and following service visits.

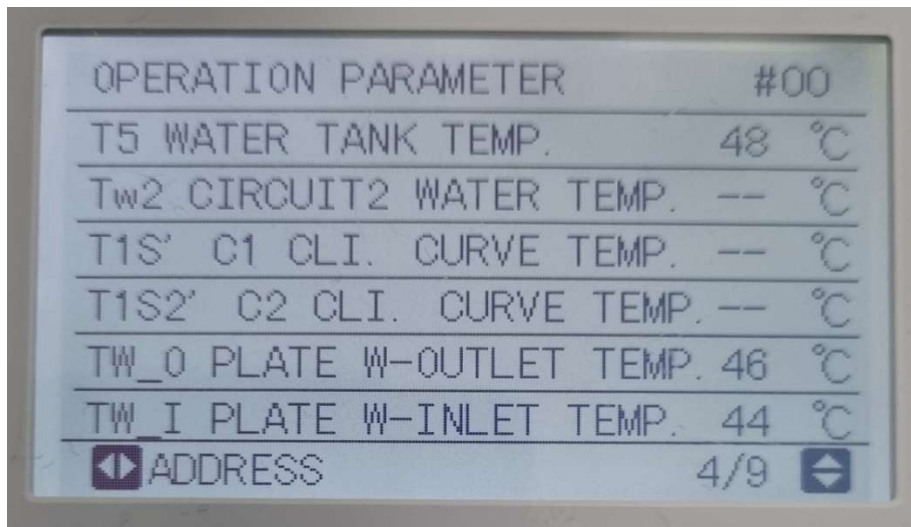


OPERATION PARAMETER	#00
T5 WATER TANK TEMP.	48 °C
Tw2 CIRCUIT2 WATER TEMP.	-- °C
T1S' C1 CLI. CURVE TEMP.	-- °C
T1S2' C2 CLI. CURVE TEMP.	-- °C
TW_0 PLATE W-OUTLET TEMP.	46 °C
TW_I PLATE W-INLET TEMP.	44 °C
◀ ADDRESS	4/9 ▶

TW\_O and TW\_I (water temp out and in should show a difference)

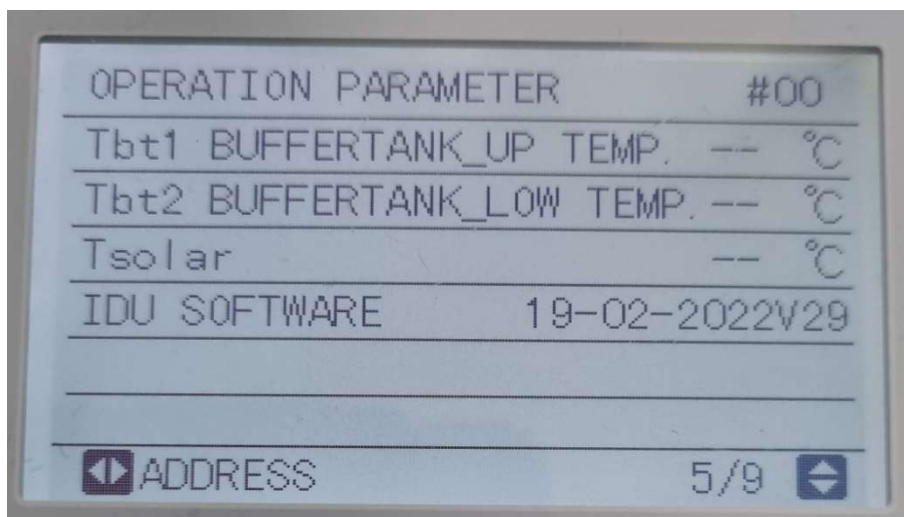

OPERATION PARAMETER	#00
Tbt1 BUFFERTANK_UP TEMP.	-- °C
Tbt2 BUFFERTANK_LOW TEMP.	-- °C
Tsolar	-- °C
IDU SOFTWARE	19-02-2022V29
◀ ADDRESS	5/9 ▶

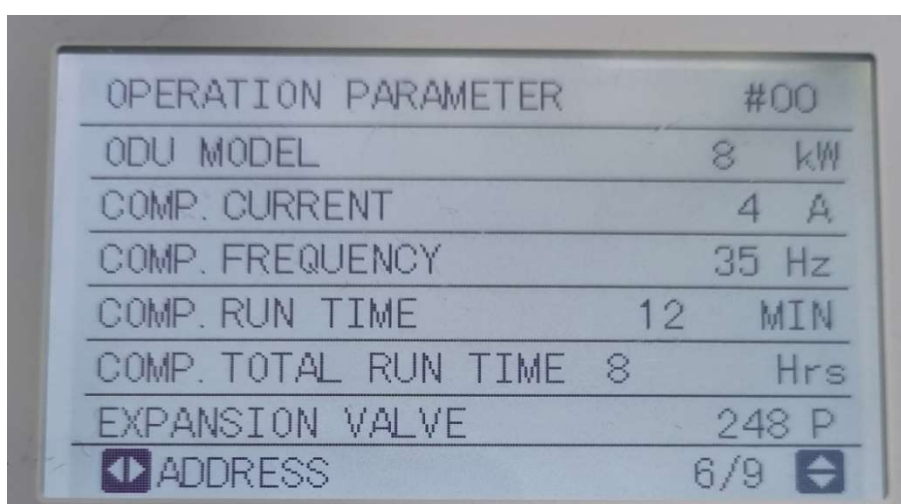

OPERATION PARAMETER	#00
ODU MODEL	8 kW
COMP. CURRENT	4 A
COMP. FREQUENCY	35 Hz
COMP. RUN TIME	12 MIN
COMP. TOTAL RUN TIME	8 Hrs
EXPANSION VALVE	248 P
◀ ADDRESS	6/9 ▶

Compressor should be on and showing its frequency along with compressor current

Please ensure compressor has been operating for a minimum of 15 minutes

Example of the operating data menu – please record and submit when commissioning and following service visits.

OPERATION PARAMETER	#00
FAN SPEED	350 R/MIN
IDU TARGET FREQUENCY	36 Hz
FREQUENCY LIMITED TYPE	0
SUPPLY VOLTAGE	236 V
DC GENERATRIX VOLTAGE	370 V
DC GENERATRIX CURRENT	6 A
◀ ADDRESS	7/9 ▶

OPERATION PARAMETER	#00
TW_0 PLATE W-OUTLET TEMP.	46 °C
TW_I PLATE W-INLET TEMP.	45 °C
T2 PLATE F-OUT TEMP.	46 °C
T2B PLATE F-IN TEMP.	51 °C
Th COMP. SUCTION TEMP.	10 °C
Tp COMP. DISCHARGE TEMP.	54 °C
◀ ADDRESS	8/9 ▶

OPERATION PARAMETER	#00
T3 OUTDOOR EXCHANGE TEMP.	11 °C
T4 OUTDOOR AIR TEMP.	15 °C
TF MODULE TEMP.	29 °C
P1 COMP. PRESSURE	2980kPa
ODU SOFTWARE	17-03-2022V62
HMI SOFTWARE	14-05-2022V35A
◀ ADDRESS	9/9 ▶

Please submit copies of all screens as it allows us to assess correct operation of the unit